
DESCRIPTION OF REVISIONS	MADE BY	DATE
RENAMED STD DWG FROM C-1064, 1 OF 2 & REVISED TITLE	RLF	9/04
2 REVISED GENERAL NOTE 1	RLF	9/04
3 RELOCATED * 4 REBAR	RLF	9/04
4)		



GENERAL NOTES

- 2 1. Concrete shall be Class S, fc=4000 PSI.
 - If the footing and Half Barrier are cast monolithically, # 6 S shape rebars are not required.
 - 3. # 4 rebar shall extend 12" past the construction joint at the completion of the day's pour.

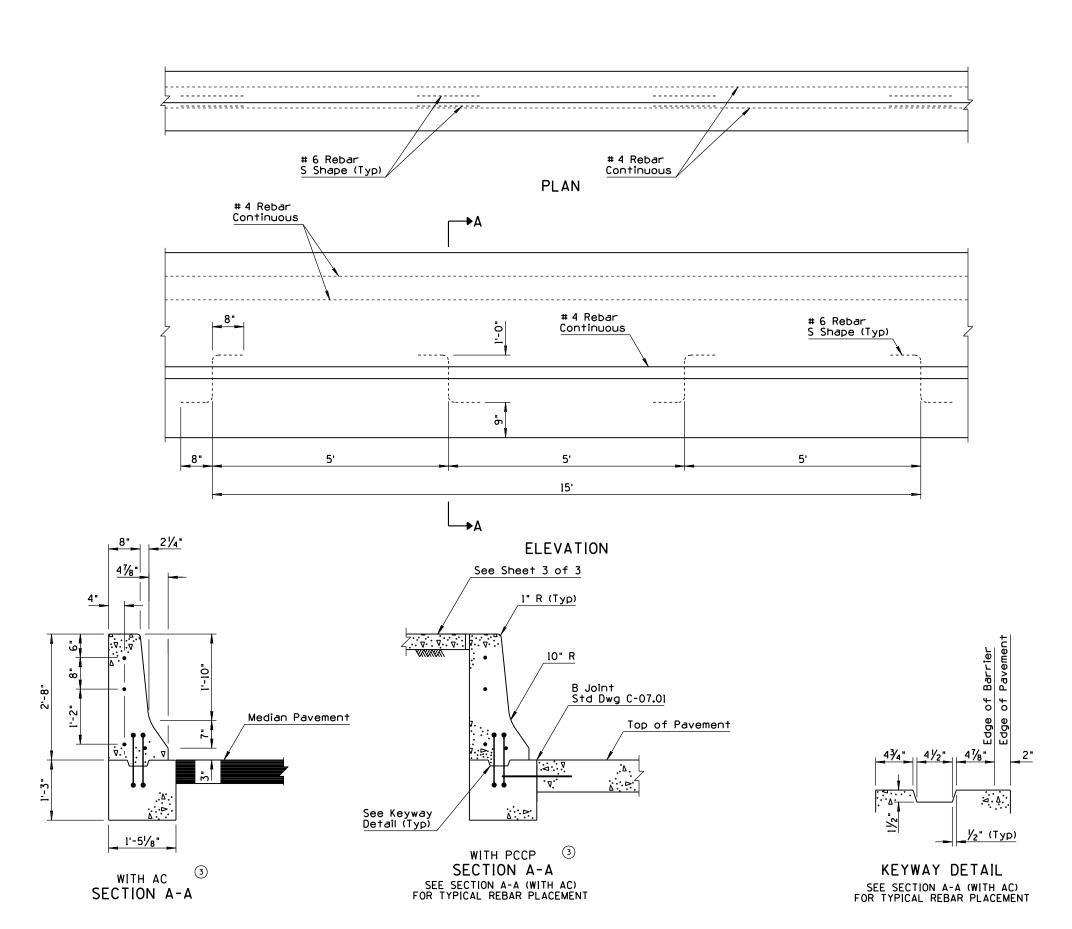